

## **Application**

The VCD-42 is a low leakage damper with extruded aluminum airfoil blades and galvanized steel frame. Smooth profile extruded aluminum airfoil blades insure the lowest resistance to airflow in HVAC systems. The VCD-42 is intended for application in medium to high pressure and velocity systems.

VCD-42 is IECC (International Energy Conservation Code) compliant with a leakage rating of 3 cfm/ft<sup>2</sup> at 1 in. wg (55 cmh/m<sup>2</sup> at .25 kPa) or less.

## **Damper Ratings**

#### **Velocity**

Up to 6000 fpm (30.5 m/s)

#### Leakage

6 cfm/ft<sup>2</sup> at 4 in. wg (110 cmh/m<sup>2</sup> at 1 kPa) 3 cfm/ft<sup>2</sup> at 1 in. wg (55 cmh/m<sup>2</sup> at .25 kPa)

#### Pressure

Up to 6 in. wg (1.5 kPa) pressure differential

#### **Temperature**

-40°F to 250°F (-40°C to 121°C).

### Construction

	Standard	Optional		
Frame Material	Galvanized Steel	-		
Frame Thickness	16 ga. (1.5 mm)	12 ga. (2.7 mm)*		
<b>Frame Type</b>	5 in. x 1 in. (127mm x 25mm) hat channel	Single flange, Reversed flange, Double flange		
Blade Material	Extruded Aluminum (6063T5)	-		
Blade Type	Airfoil	-		
Blade Action	Opposed	Parallel		
Linkage	Plated steel out of airstream, concealed in jamb	316SS		
Axle Bearings	Synthetic (acetal) sleeve	316SS		
Axle Material	Plated steel	316SS		
Blade Seals	TPE	Silicone		
Jamb Seals	Stainless Steel	-		
Finish	MIII finish	Baked Enamel, Hi Pro Polyester, Industrial Epoxy		


\*When 12 ga. frame is selected and the damper height is less than 17 inches, low profile top and bottom frame members are utilized. These low profile frame members will be made from 16 ga. material.



\*W&H dimension furnished approximately 1/4 in. (6mm) undersize.

### **Size Limitations**

W x H Minimum		Maximum Size					
WXII	Size	Single Section	Multiple Section				
Inches	6 x 6	60 x 74	Unlimited				
mm	152 x 152	1524 x 1880	Unlimited				



#### **Notes:**


- Low profile head and sill are used on sizes less than 17 in. (432mm) high
- Electric actuator and manual quadrant available. Factory supplied actuators are sized for 1500 fpm (7m/s) and fully closed differential pressure of 2 in. wg (.5 kPa). Contact factory for actuator sizing on applications exceeding those limits.
- In applications where airflow could be uneven, such as a discharge fan, it is imperative to verify that at no point the maximum velocity exceeds the damper's cataloged velocity.
- Blades must be horizontal for either horizontal or vertical mount.

VCD-42 January 2025

## **Blade Operation**

**Parallel blade operation** - this configuration requires the damper blades to rotate in the same direction, parallel to one another.


**Opposed blade operation -** adjacent damper blades rotate opposite one another.




## **Options**

- Actuators (24V, 120V, manual, pull chain)
- Actuator mounting (external, external kit (field assembly), internal)
- Flanges
- NEMA enclosures (3, 4, 4X, 7)
- Retaining angles
- Transformers

### Flange options





Single Flange

Reversed Flange

**Double Flange** 

Shown with optional internally mounted actuator.

VCD-42 January 2025

## **Pressure Drop Data**

This pressure drop testing was conducted in accordance with AMCA Standard 500-D using the three configurations shown. All data has been corrected to represent standard air at a density of 0.075 lb/ft3 (1.201 kg/m3).


Actual pressure drop found in any HVAC system is a combination of many factors. This pressure drop information along with an analysis of other system influences should be used to estimate actual pressure losses for a damper installed in a given HVAC system.

## **AMCA Test Figures**

**Figure 5.3** Illustrates a fully ducted damper. This configuration has the lowest pressure drop of the three test configurations because entrance and exit losses are minimized by straight duct runs upstream and downstream of the damper.

**Figure 5.2** Illustrates a ducted damper exhausting air into an open area. This configuration has a lower pressure drop than Figure 5.5 because entrance losses are minimized by a straight duct run upstream of the damper.

Figure 5.5 Illustrates a plenum mounted damper. This configuration has the highest pressure drop because of extremely high entrance and exit losses due to the sudden changes of area in the system.

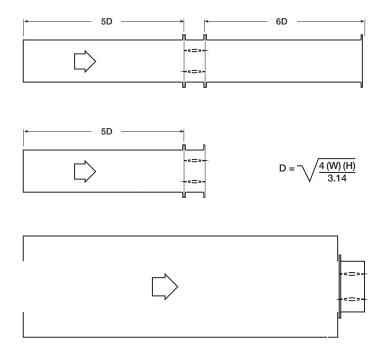


Dimension inches		12x12			24×24			36x36	•		12x48			48x12	
AMCA figure	5.2	5.3	5.5	5.2	5.3	5.5	5.2	5.3	5.5	5.2	5.3	5.5	5.2	5.3	5.5
Velocity (ft/min)	Pressure Drop in. wg														
500	.05	.03	.07	.01	.01	.04	.01	.01	.02	.01	.01	.03	.03	.02	.05
1000	.18	.12	.28	.05	.03	.17	.04	.02	.12	.01	.04	.18	.11	.06	.19
1500	.43	.28	.62	.12	.06	.37	.09	.05	.28	.14	.09	.40	.25	.14	.44
2000	.76	.49	1.11	.22	.11	.66	.17	.08	.50	.25	.16	.72	.44	.25	.78
2500	1.19	.77	1.73	.34	.17	1.04	.26	.13	.78	.39	.25	1.12	.69	.39	1.21
3000	1.71	1.11	2.50	.49	.24	1.50	.38	.19	1.13	.57	.36	1.62	1.0	.57	1.75
3500	2.33	1.51	3.41	.66	.33	2.04	.51	.26	1.53	.77	.49	2.21	1.36	.77	2.38
4000	3.04	1.98	4.45	.87	.43	2.66	.67	.34	2.01	1.01	.64	2.88	1.78	1.01	3.11


VCD-42 Jnauary 2025

# Leakage


Damper leakage (with blades fully closed) varies based on the type of low leakage seals applied. Model VCD-42 is available with silicone blade seals and stainless steel jamb seals. Leakage testing was conducted in accordance with AMCA Standard 500-D and is expressed as cfm/ft<sup>2</sup> of damper face area. All data has been corrected to represent standard air at a density of 0.075 lb/ft3 (1.201 kg/m3).

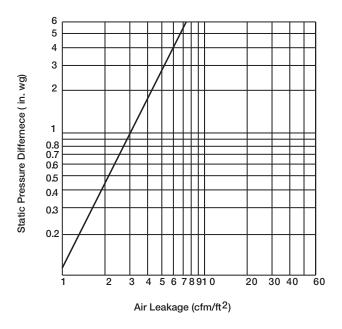

### **Pressure Limitations**

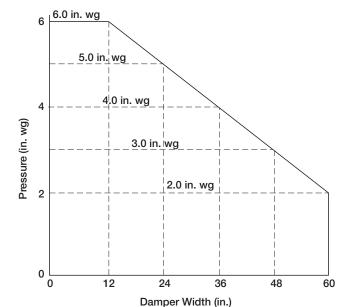

## **Velocity Limitations**

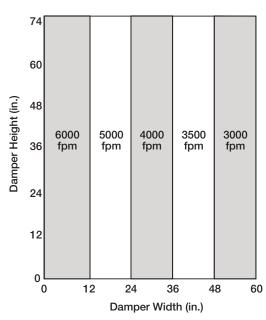

# **Temperature Limitations**


Blade Seal	Temperature Range				
TPE	-10°F to 180°F (-23°C to 82°C)				
Silicone	-40°F to 250°F (-40°C to 121°C)				

**NOTE:** VCD-42 will withstand higher pressures and velocities. Displayed ratings are conservative to prevent misapplication. Consult factory if you have an application outside these limitations.

VCD-42 January 2025

# **Space Envelopes**

On dampers less than 18 in. (457mm) high, actuators may also require clearances above and/or below the damper frame. "B" and "T" dimensions are worst case clearance requirements for some dampers less than 18 in. (457mm) high. All damper sizes under 18 in. (457mm) high do not require these worst case clearances. If space availability above or below the damper is limited, each damper size should be individually evaluated.



A -tt T /AA - J-1	Height	T	В	D			
Actuator Type/Model	Inches	Inches					
AFBUP (-S) and	≥6 to <10	0	12¾	61/4			
FSNF Series, Belimo	≥10 to <18	0	2	61/4			
MSxx20 Series, Honeywell	<u>≥</u> 18	0	0	61/4			
FSLF, LF and TFB Series, Belimo	≥6 to <10	0	3⅓	61/4			
rour, ir and ird beries, beiling	≥10	0	0	61/4			
MSxx04 & MSxx09 Series,	≥6 to <9	0	43/4	61/4			
Honeywell	<u>≥</u> 9	0	0	61/4			
	≥6 to <10	0	12¾	61/4			
MS75xx Series, Honeywell	≥10 to <18	0	7	61/4			
	<u>&gt;</u> 18	0	0	61/4			
GRD and GVD Series, Siemens	≥6 to <10	0	12¾	61/4			
	≥10 to <18	0	2	61/4			
	≥18	0	0	61/4			
GJD Series, Siemens	≥6 to <10	0	31/2	61/4			
	≥10 to <18	0	0	61/4			
	<u>≥</u> 18	0	0	61/4			

VCD-42 Jnauary 2025

## **Actuator Mounting**

Actuators may be installed at the factory or shipped loose with the necessary linkage and brackets required for mounting. For more detail

information on actuator mounting, click on link below or scan QR code.




Non-jackshaft external right

## **Clearance Requirements**

This drawing depicts the worse case clearance requirements for an actuator with a jackshaft.

Internal mount only Actuator model	A	В	С
All except - EFB & EFCX	7 <sup>3</sup> / <sub>4</sub> in (197 mm)	3 <sup>3</sup> / <sub>4</sub> in	5 3/8 in
Series		(95 mm)	(136.5 mm)
EFB & EFCX Series	8 ½ in	6 in	8 ½ in
	(216 mm)	(152mm)	(216 mm)




VCD-42 January 2025

## **Multi-Section Dampers**

Dampers larger than the maximum single section size, will be made up of a multiple of equal size sections. Multiple section dampers can be jackshafted together so that all sections operate together as shown below.

**Note:** Dampers larger than 60 in.  $\times$  74 in. (1524mm  $\times$  1880mm) are not intended to be structurally self supporting. Refer to IOM document 483509 for structural support requirements on multi-section assemblies.

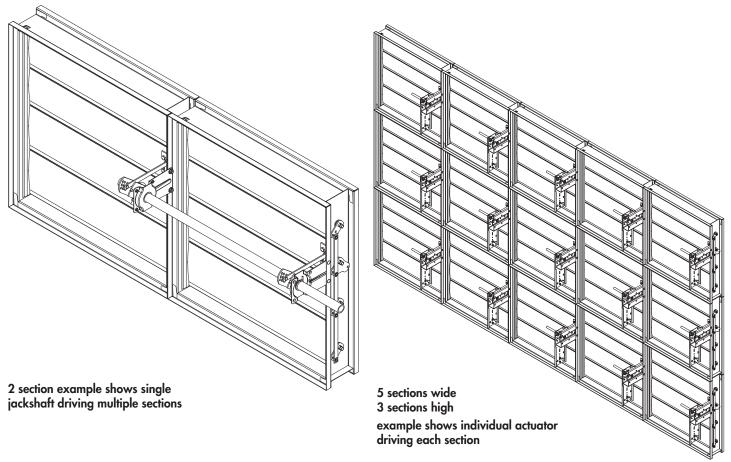

### **Document Links**



INSTALLATION



**CATALOG** 



SELECTION GUIDE



**WARRANTY** 

